

HeatingBOX 230V 2X v2

Heating actuator for up to 2 outputs 230 VAC and 2 A/D inputs

#### ZCL2H230V2

### **TECHNICAL DOCUMENTATION**

### **FEATURES**

- 2 configurable outputs for 230 VAC valve control
- 2 thermostats
- 2 analog/digital inputs
- 10 logic functions
- Manual control through buttons and LED status indicators
- Common 230 VAC input supply for all the outputs
- Total data saving on KNX bus failure
- Integrated KNX BCU (TP1-256)
- Dimensions 67 x 90 x 36 mm (2 DIN units)
- DIN rail mounting according to IEC 60715 TH35, with fixing clamp
- Conformity with the CE, UKCA, RCM directives (marks on the right side)




Figure 1: HeatingBOX 230V 2X v2

1. Valve outputs 2. 230	0 V input (phase)	3. 230 V input/output (neutral)	4. Output status LED	5. Output control button
6. Programming/Test Button		7. Programming/Test LED	8. KNX connector	9. Analog/Digital inputs

Programming/Test button: short press to set programming mode. If this button is held while plugging the device into the KNX bus, it enters the safe mode. If this button is held for more than 3 seconds, the device enters the test mode.

Programming/Test LED: programming mode indicator (red). When the device enters the safe mode, it blinks (red) every half second. The manual mode is indicated by the green color. During the start-up (reset or after KNX bus failure) and if the device is not in safe mode, it emits a red flash.

GENERAL S	<b>SPECIFICATIO</b>	NS				
CONCEPT		DESCRIPTION				
Type of device		Electric operation control device	Electric operation control device			
	Voltage (typica	al)	29 VDC SELV			
	Voltage range	•	21-31 VDC			
	Maximum	Voltage	mA	mW		
KNX supply		29 VDC (typical)	5.9	171.1		
	consumption	24 VDC <sup>1</sup>	10	240		
	Connection ty	ре	Typical TP1 bus connector for	0.8 mm Ø rigid cable		
External powe	er supply		230 V 50/60 Hz			
Operation tem	perature		0 +55 °C			
Storage tempe	erature		-20 +55 °C	-20 +55 °C		
Operation hun	nidity		5 95%			
Storage humic			5 95%	595%		
Complementa	ry characteristic	S	Class B	Class B		
Protection clas	ss / Overvoltage	category	II / III (4000 V)	II / III (4000 V)		
Operation type	Э		Continuous operation			
Device action type		Type 1				
Electrical stress period		Long				
Degree of protection / Pollution degree		IP20 / 2 (clean environment)				
Installation			Independent device to be mounted inside electrical panels with DIN rail (IEC 60715)			
Minimum clearances		Not required				
Response on	Response on KNX bus failure		Data saving according to parameterization			
Response on KNX bus restart		Data recovery according to parameterization				
Operation indicator		The programming LED indicates programming mode (red) and test mode (green). Each output LED indicates its status (fixed=active output; flashing=overload or short-circuit). The blue blinking of the programming LED indicates a 3 minutes lock due to the suffering of 4 short-circuits/overloads in less than 3 minutes.				
Weight		115 g				
PCB CTI index		175 V				
Housing material / Ball pressure test temperature		PC FR V0 halogen free / 75 °C	C (housing) - 125 °C (connectors)			

<sup>1</sup> Maximum consumption in the worst-case scenario (KNX Fan-In model).

		IECTIONS
OUTPUTS SPECIFICATIONS AND CONI		DESCRIPTION
Number of outputs		2
Output type		Solid state switching device
Maximum	Quantity of valves <sup>2</sup>	5
recommended load	Stationary current	200 mA (@ 35 °C)
per output (AC/DC)	Maximum inrush current	2.5 A
Short-circuit protection		YES
Overload protection		YES
Connection method		Screw terminal block (0.4 Nm max.)

<sup>2</sup> It is allowed to connect up to 5 valves per output as long as the maximum stationary and inrush current of the output is not exceeded.


0.5-2.5 mm<sup>2</sup> (IEC) / 26-12 AWG (UL)

EXTERNAL POWER SUPPLY SPECIFICATIONS AND CONNECTIONS		
CONCEPT	DESCRIPTION	
Voltage	230 VAC 50/60 Hz	
Connection method	Screw terminal block (0.4 Nm max.)	
Cable cross-section	0.5-2.5 mm <sup>2</sup> (IEC) / 26-12 AWG (UL)	


INPUTS SPECIFICATIONS AND CONNECTIONS		
CONCEPT	DESCRIPTION	
Number of inputs	2	
Inputs per common	1	
Operation voltage	+3.3 VDC in the common	
Operation current	1 mA @ 3.3 VDC (per input)	
Switching type	Dry voltage contacts between input and common	
Connection method	Screw terminal block (0.4 Nm max.)	
Cable cross-section	0.5-2.5 mm <sup>2</sup> (IEC) / 26-12 AWG (UL)	
Maximum cable length	30 m	
NTC accuracy (@ 25 °C) <sup>3</sup>	±0.5 °C	
Temperature resolution	0.1 °C	
Maximum response time	10 ms	
<sup>3</sup> For Zennio temperature probes.		

For Zennio temperature probes.

Cable cross-section

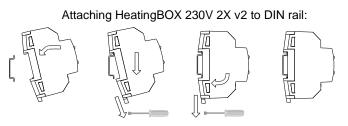

Removing HeatingBOX 230V 2X v2 from DIN rail:



# WIRING DIAGRAM





Figure 2: Wiring example: one valve per output and several valves per output.

▲ Simultaneous connection of one valve to several outputs is not allowed.

### INPUTS CONNECTION

Any combination of the following accessories is allowed in the inputs:





▲ Commons of different devices must not be connected together.

\* Zennio temperature probe or any NTC with known resistance values at three points in the range [-55, 150 °C].

ERROR	VISUAL NOTIFICATION
Short circuit on V1	V1 V2 Prog. LED (blue) 1 $\begin{pmatrix} 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 \\ 0 $
Overload on V1-V2 group	V1 V2 1 $2$ Prog. LED (blue) 1 $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$
Lock due to short circuit / overvoltage	V1 V2 Prog. LED (blue) 1 $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$ $2$

## SAFETY INSTRUCTIONS AND ADDITIONAL NOTES

- Installation should only be performed by qualified professionals according to the laws and regulations applicable in each country.
- Do not connect the mains voltage nor any other external voltage to any point of the KNX bus; it would represent a risk for the entire KNX system. The facility must have enough insulation between the mains (or auxiliary) voltage and the KNX bus or the wires of other accessories, in case of being installed.
- The facility must be equipped with a device that ensures the omnipolar sectioning. Installation of a 10 A mini-circuit-breaker is recommended. To prevent accidents, it must remain open in case of manipulation of the device.
- Once the device is installed (in the panel or box), it must not be accessible from outside.
- Keep the device away from water (condensation over the device included) and do not cover it with clothes, paper or any other material while in use.
- The WEEE logo means that this device contains electronic parts and it must be properly disposed of by following the instructions at https://www.zennio.com/en/legal/weee-regulation.
  - This device contains software subject to specific licences. For details, please refer to https://zennio.com/licenses.

© Zennio Avance y Tecnología S.L.